


Insert site map highlighting areas with odour issues; see example of Wanlip STW

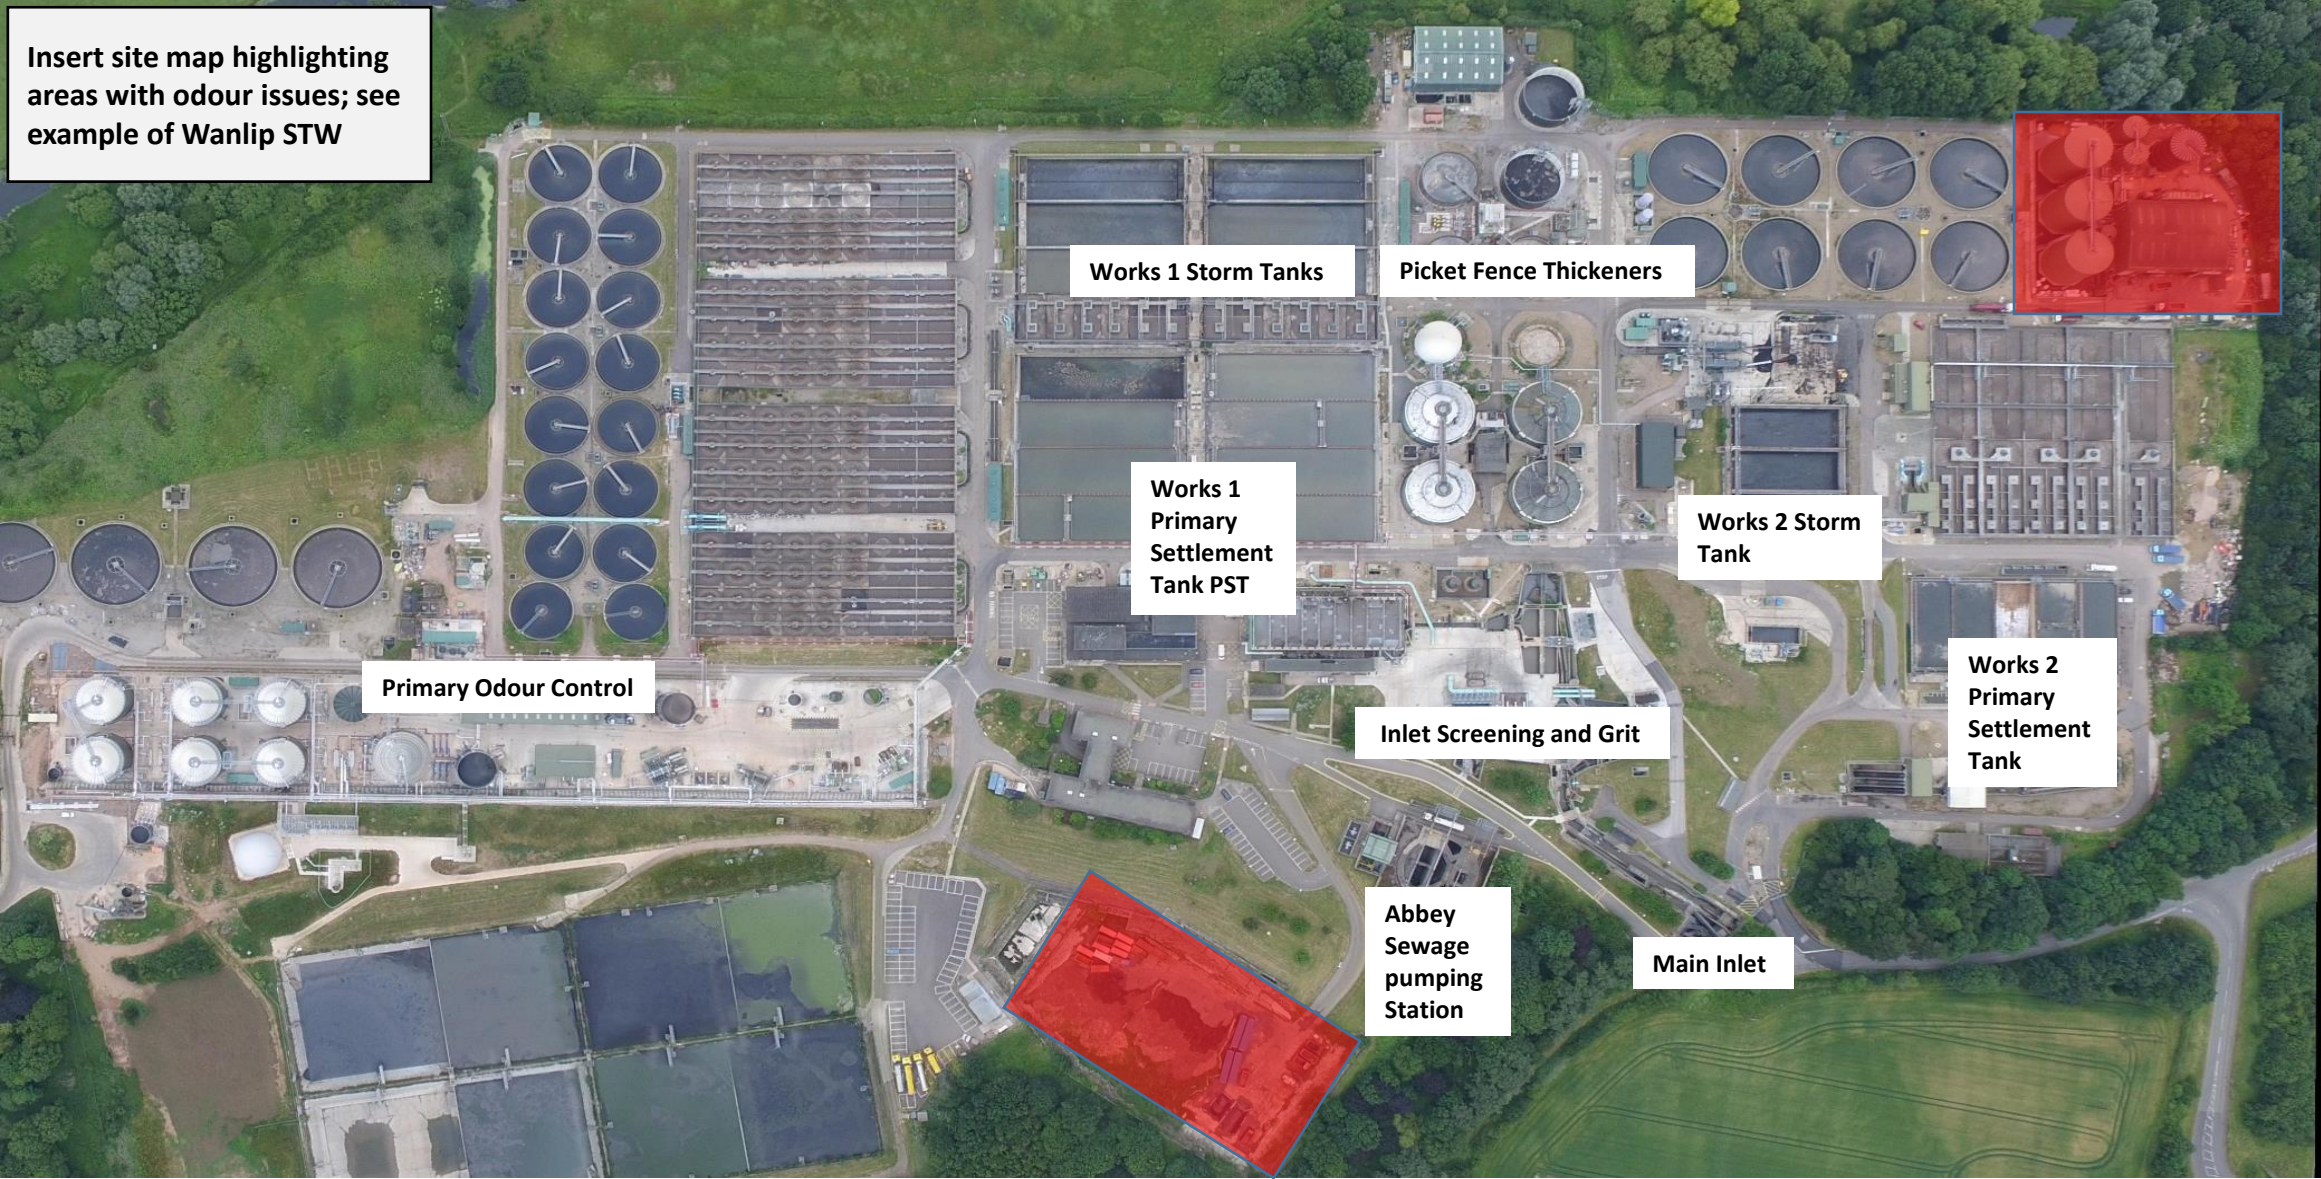

Odour site visit checks

Biffa

**Site Odour Check List**

Site name: Wanlip

Time and Date: 04/12/2024

Print Initials: LM

Circle: Reactive or Proactive (Record customer details in actions/next steps for Reactive complaints)

**1. Wind direction**

Specify..... NE 5MPH

**8. Weather conditions**

Specify - Dry - Cold

**2. Flows into works/ FFT 3600 L/S**

High (2800-3600 L/s) Medium (1300-2800 l/s) Low (0-1300 l/s)

**Actual flow -**

2368 L/S

**9. Odour present at inlet channel?**

High Medium Low

**10. Any odour present at plants operated by other businesses (e.g. Biffa)?**

High Medium Low

**11. Is on site odour control working?**

YES NO

**13. Any other operational issue potentially effecting odour?**

YES NO

**3. Odour present at on site SPS?**

Yes No

**4. Screenings and grit removed from site as per contact agreement (Inlet, PFT and CDE)?**

Yes No

**5. Out of service PST's drained and cleaned?**

Yes No

**6. Out of service PFT's drained and cleaned?**

Yes No

**7. PFT and PST Red Golden Measure ALB's?**

Yes No

**Actions/Next Steps/ OOS Assets/ Any additional information regarding site issues etc.**

Biffa: Garage doors open 4  
N/W PST 4 OOS  
O/W PST 8 OOS  
O/W Lane 2 Aerator 1 OOS  
O/W Lane 9 mixer 1 OOS  
O/W Lane 9 mixer4 OOS  
O/W Lane 9 Aerator 3 OOS  
O/W Lane 9 Aerator 5 OOS  
O/W Lane 9 Aerator 6 OOS  
O/W Lane 11 Aerator 1 OOS  
O/W Lane 15 mixer 4 OOS  
O/W Lane 15 Aerator 3 OOS  
O/W Lane 16 mixer 1 OOS  
O/W Lane 16 Aerator 3 OOS

**13. Any other known area odours?**

YES NO

**Key:**

- CDE screens = imported sludge screens
- PST = primary settlement tanks
- PFT = Picket Fence Thickener
- SPS = sewage pumping station
- ALB = action limit breach
- L/S = Litres per second
- FFT = Full flow treatment before we divert to storm tanks