


Insert site map highlighting areas with odour issues; see example of Wanlip STW



Odour site visit checks

Biffa

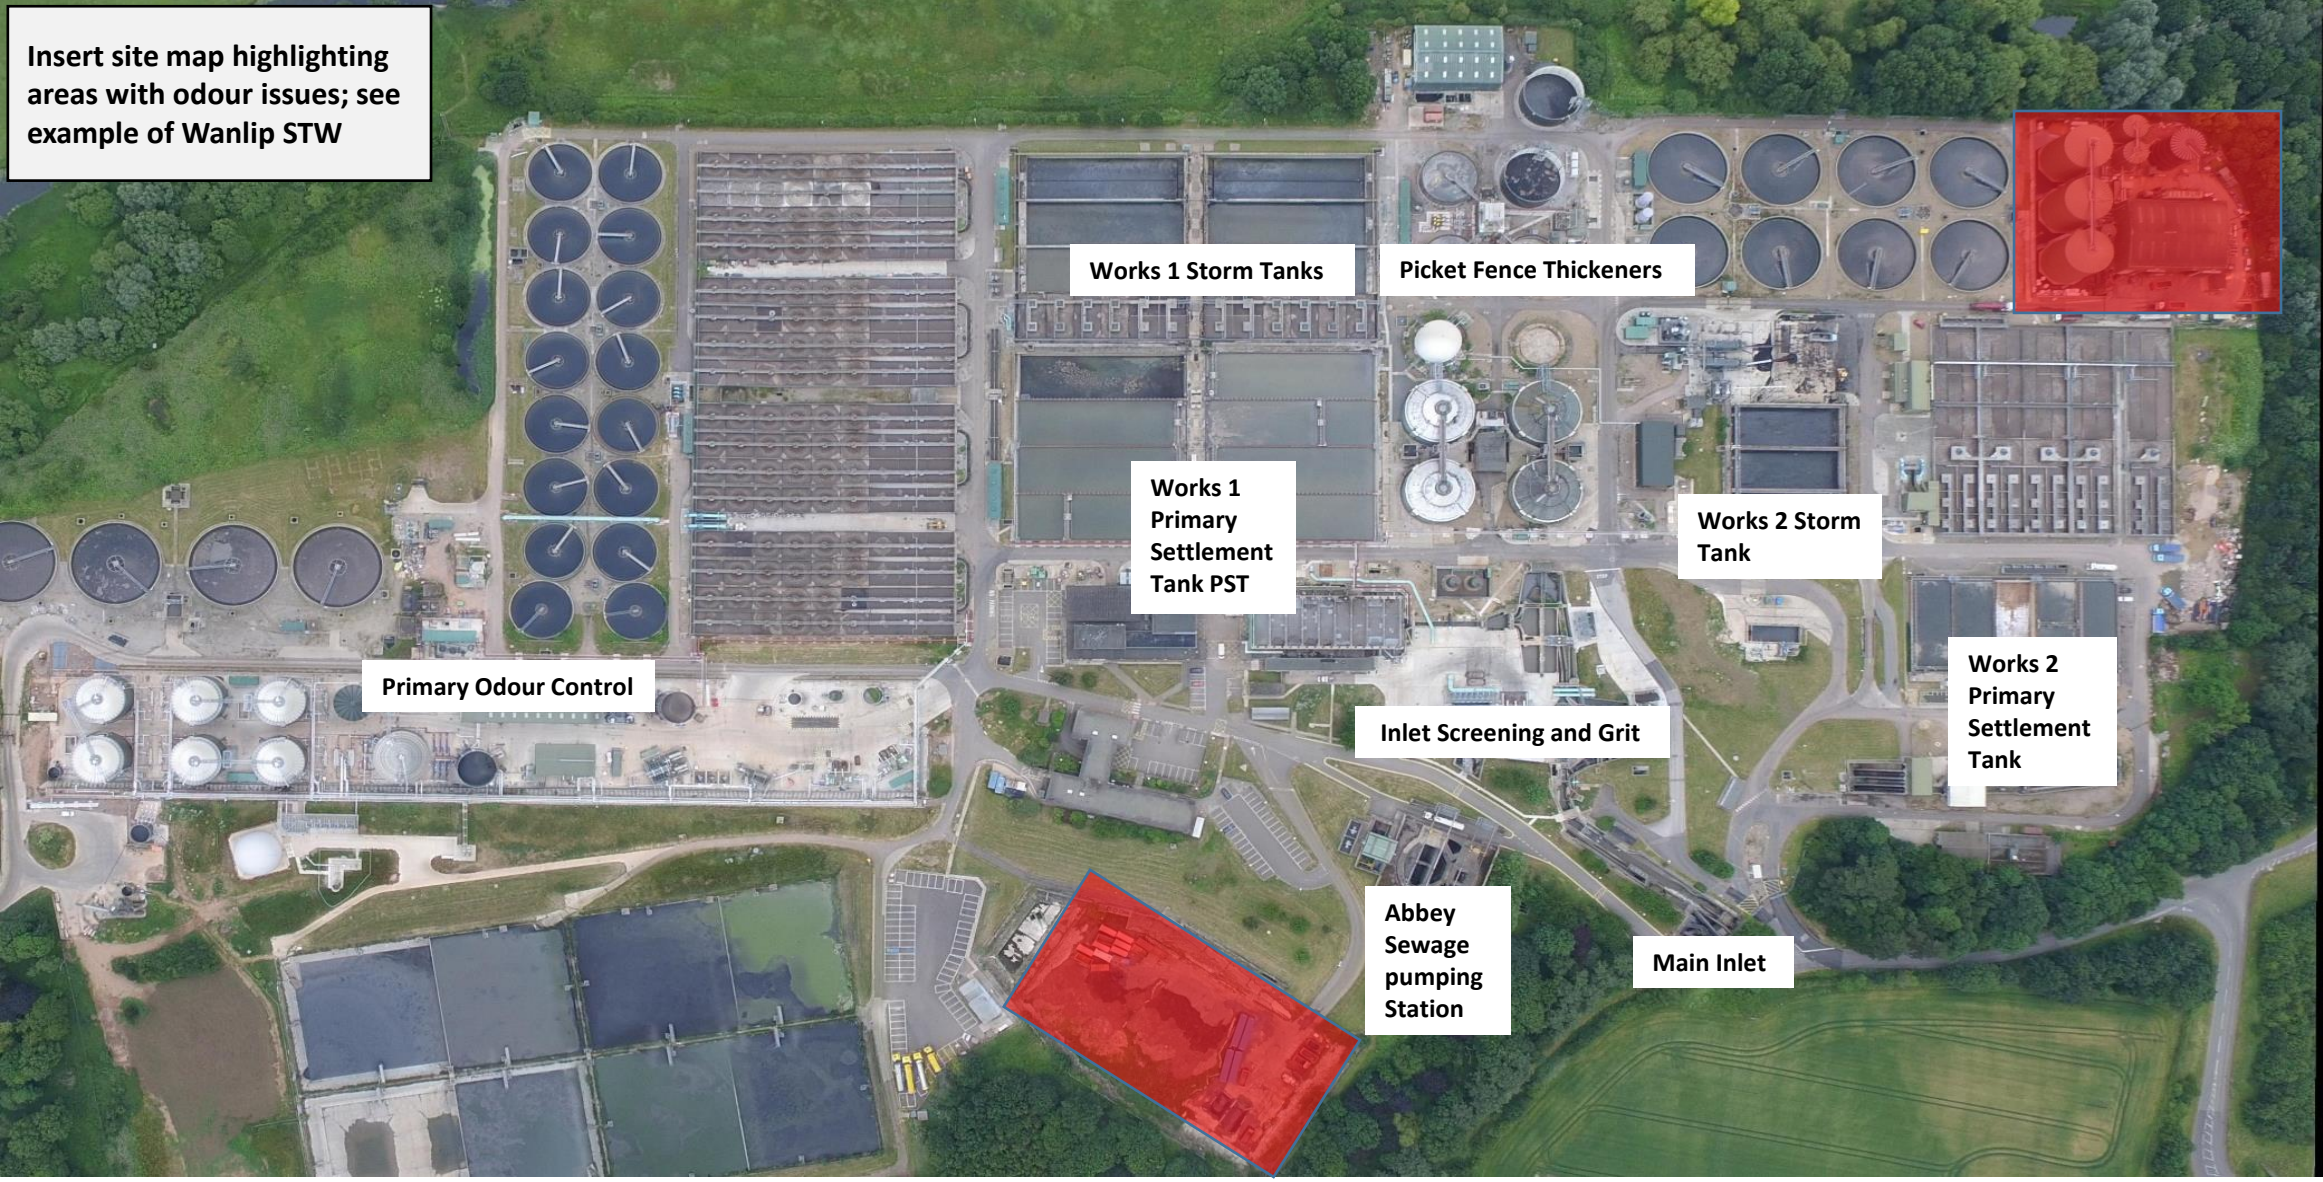

**Site Odour Check List**

Site name: Wanlip

Time and Date: 14/10/2024 8:00am

Print Initials: ES

Circle: Reactive or **Proactive** (Record customer details in actions/next steps for Reactive complaints)

**1. Wind direction**

Specify..... 7mph West

**8. Weather conditions**

Specify - Rain

**Medium**

Low

**2. Flows into works/ FFT 3600 L/S**

High (2800-3600 L/s) Medium (1300-2800 l/s) Low (0-1300 l/s)

**9. Odour present at inlet channel?**

High

**Medium**

Low

**10. Any odour present at plants operated by other businesses (e.g. Biffa)?**

**11. Is on site odour control working?**

**YES**

NO

**13. Any other operational issue potentially effecting odour?**

YES

**NO**

**13. Any other known area odours?**

YES

**NO**

**3. Odour present at on site SPS?**

Yes

**No**

**4. Screenings and grit removed from site as per contact agreement (Inlet, PFT and CDE)?**

**Yes**

No

**5. Out of service PST's drained and cleaned?**

Yes

**No**

**6. Out of service PFT's drained and cleaned?**

**Yes**

No

**7. PFT and PST Red Golden Measure ALB's?**

Yes

**No**

**Actions/Next Steps/ OOS Assets/ Any additional information regarding site issues etc.**

- Biffa: Garage doors open 2
- O/W PST 8 OOS
- N/W PST 2 OOS
- O/W Lane 1 Aerator 5 OOS
- O/W Lane 2 Aerator 1 OOS
- O/W Lane 2 Aerator 4 OOS
- O/W Lane 9 mixer 1 OOS
- O/W Lane 9 Aerator 3,5,6 OOS
- O/W Lane 11 Aerator 1 OOS
- O/W Lane 13 Aerator 2 OOS
- O/W lane 15 mixer 4 OOS
- O/W Lane 16 Aerator 5 OOS
- O/W FST 5 OOS

**Key:**

- CDE screens = imported sludge screens
- PST = primary settlement tanks
- PFT = Picket Fence Thickener
- SPS = sewage pumping station
- ALB = action limit breach
- L/S = Litres per second
- FFT = Full flow treatment before we divert to storm tanks